


# Drawing: 2 WallNat G2's, 1 Storage Tank

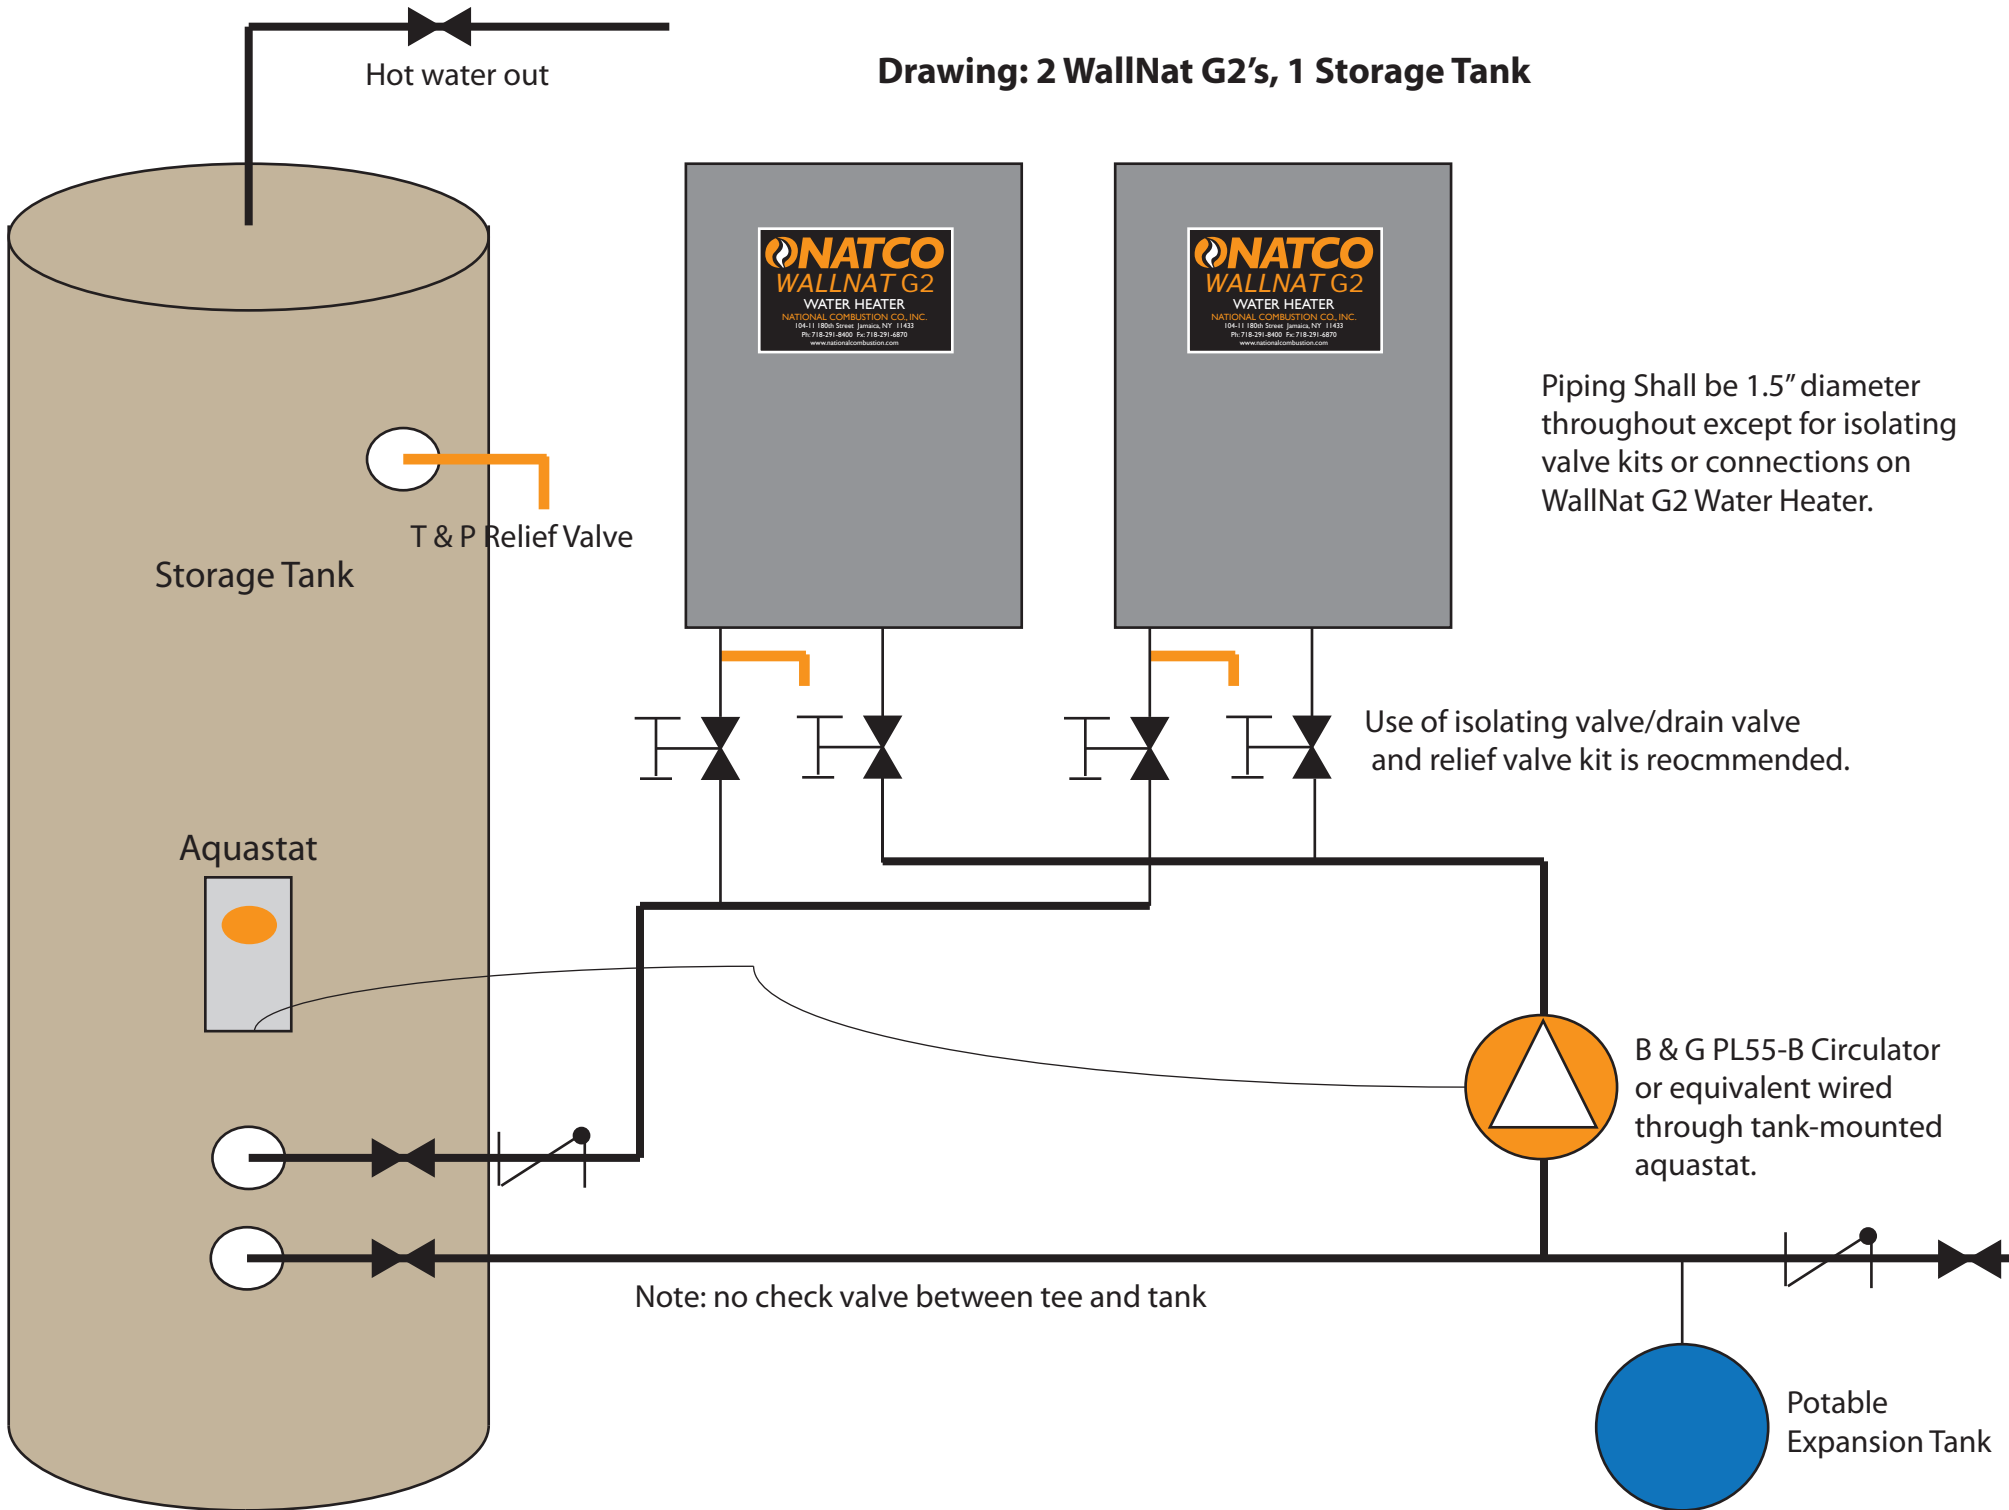

Piping Shall be 1.5" diameter throughout except for isolating valve kits or connections on WallNat G2 Water Heater.

Use of isolating valve/drain valve and relief valve kit is recommended.

B & G PL55-B Circulator or equivalent wired through tank-mounted aquastat.

Note: no check valve between tee and tank

Potable Expansion Tank