




National Combustion Co., Inc.  
 104-11 180th Street  
 Jamaica, NY 11433  
 Ph: 718-291-8400  
 Fx: 718-291-6870

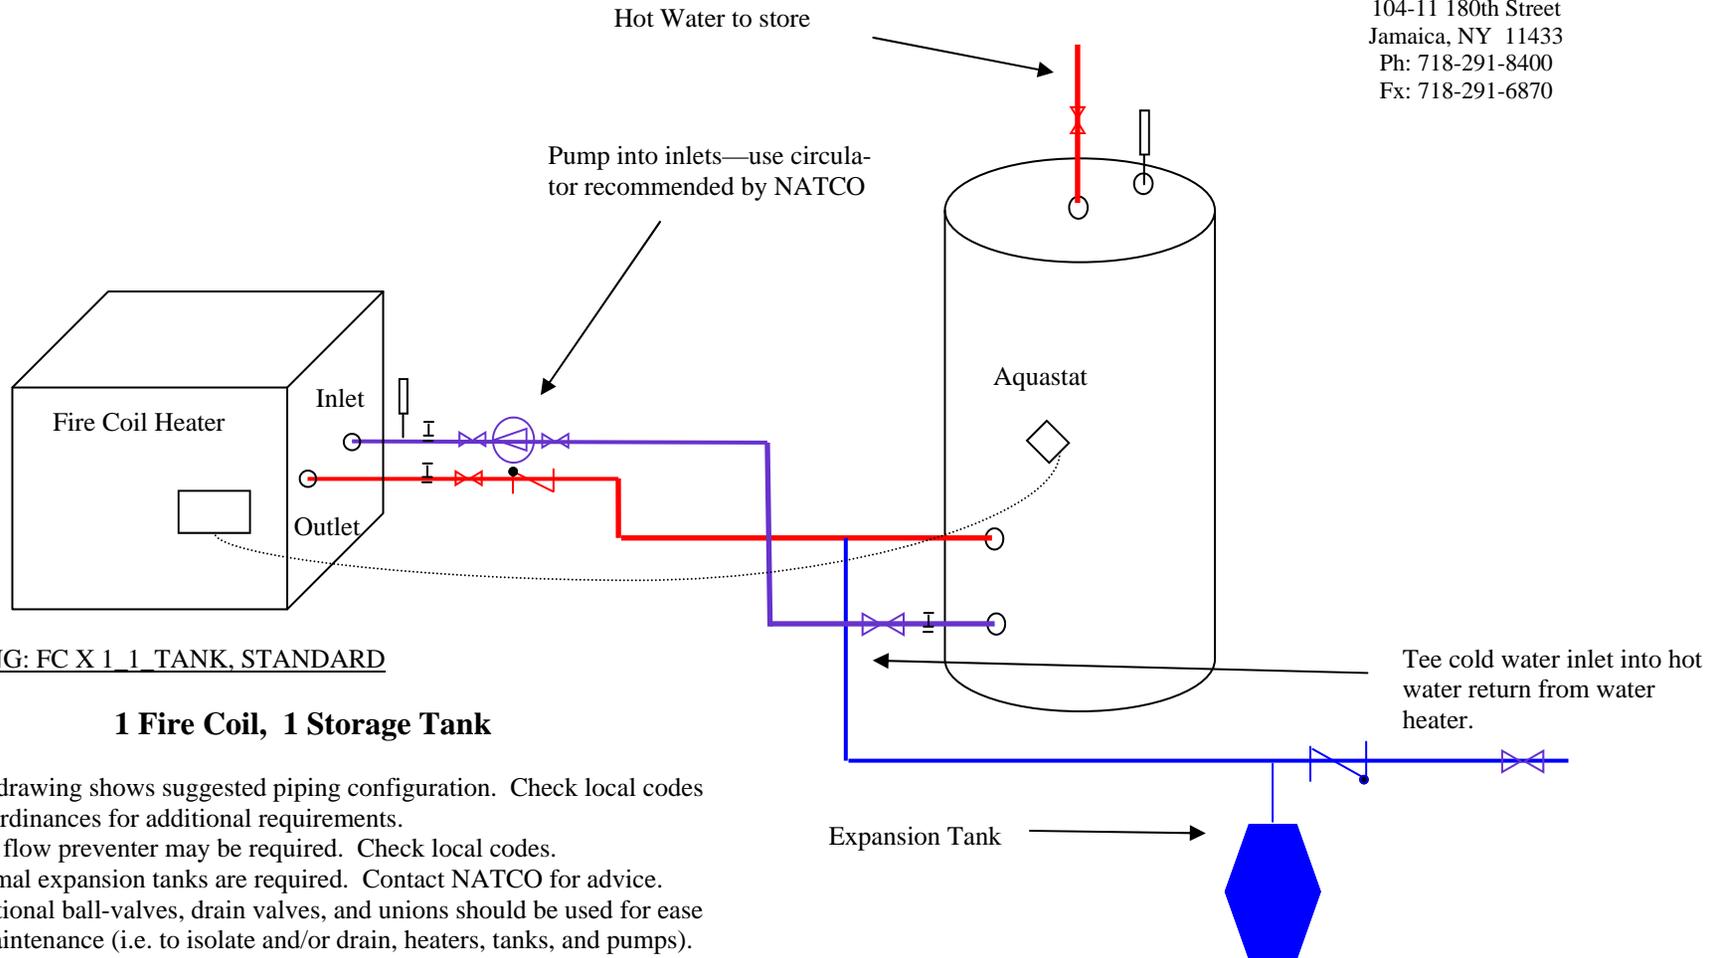


DRAWING: FC X 1 1 TANK, STANDARD

**1 Fire Coil, 1 Storage Tank**

Notes:

1. This drawing shows suggested piping configuration. Check local codes and ordinances for additional requirements.
2. Back flow preventer may be required. Check local codes.
3. Thermal expansion tanks are required. Contact NATCO for advice.
4. Additional ball-valves, drain valves, and unions should be used for ease of maintenance (i.e. to isolate and/or drain, heaters, tanks, and pumps).
5. Suggested pipe size must be used throughout, with bushings used to meet connections as necessary. Supply and return pipe diameter must be the same.

Legend



**Pipe Size between heater/tank**

Heater Model	Pipe Size (NPS)
PFC 125-400	1-1/2"
FC 500-850	2"
FC 1010-1825	2-1/2"
Greater	Call