




National Combustion Co., Inc.

104-11 180th Street

Jamaica, NY 11433

Ph: 718-291-8400

Fx: 718-291-6870

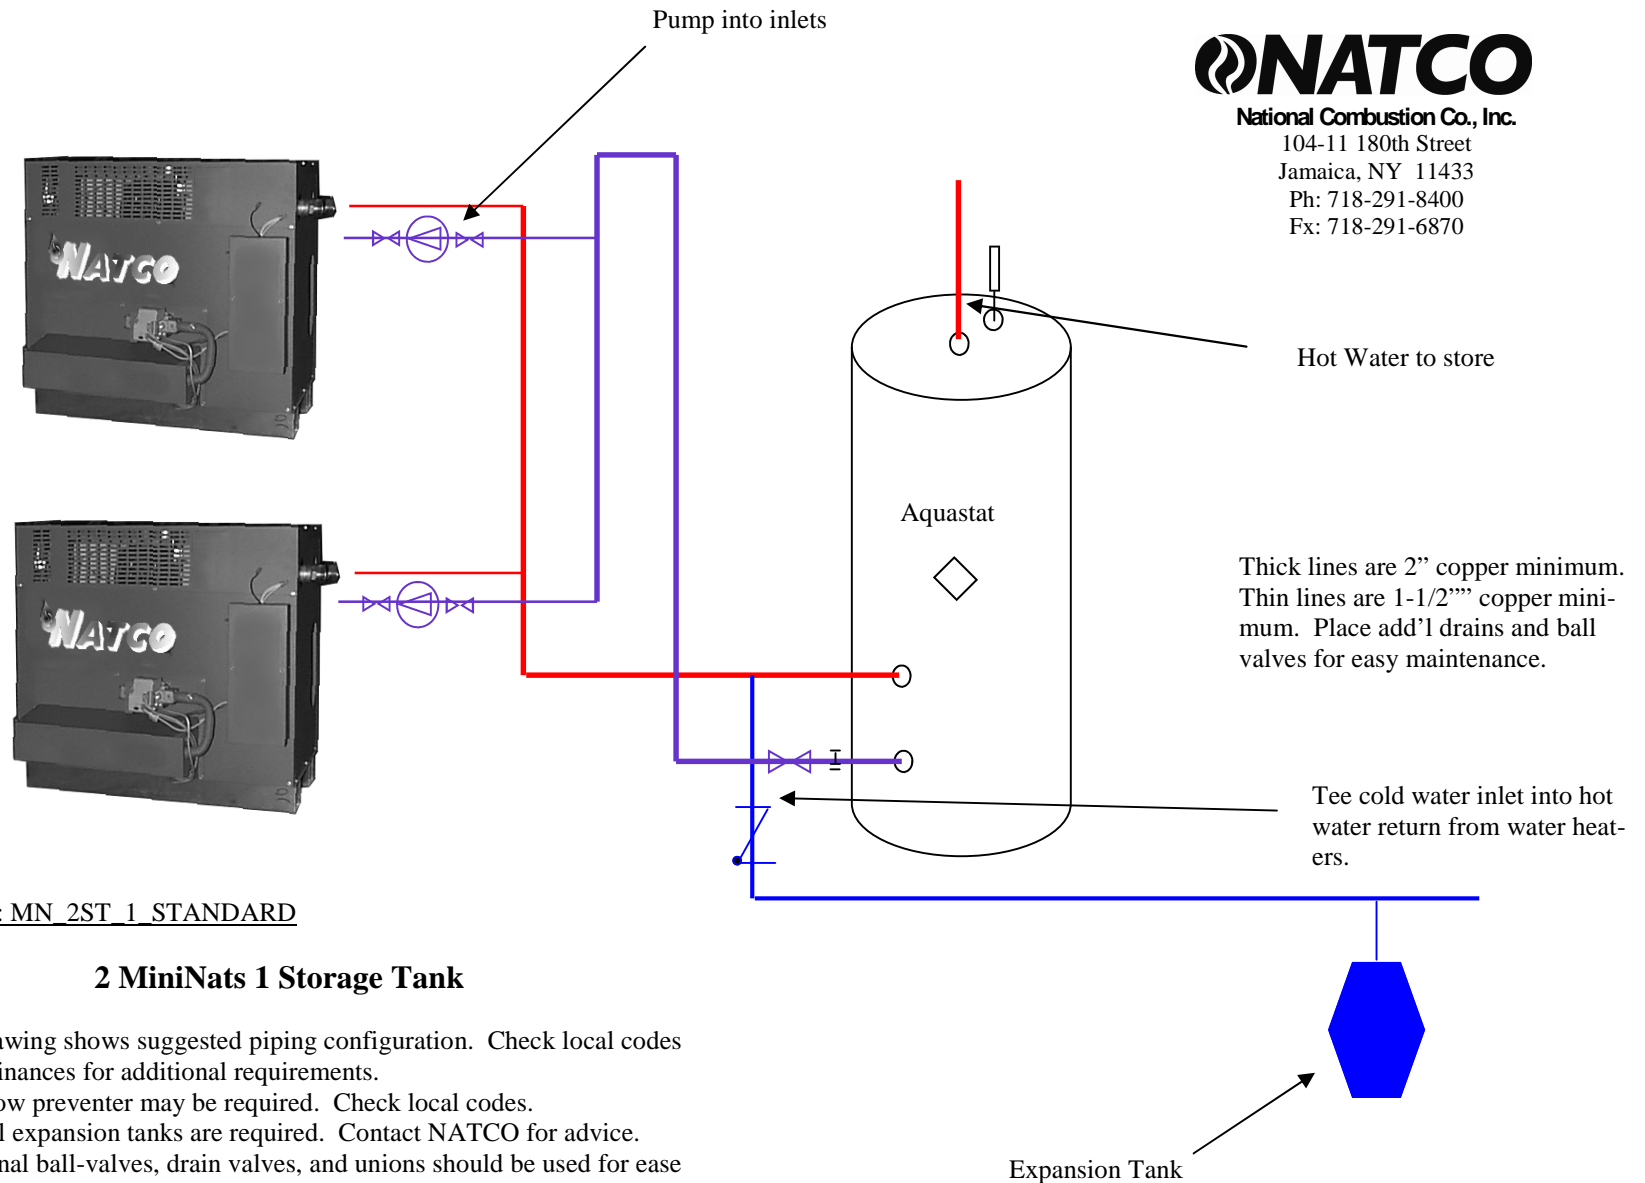

DRAWING: MN\_2ST\_1\_STANDARD

## 2 MiniNats 1 Storage Tank

### Notes:

1. This drawing shows suggested piping configuration. Check local codes and ordinances for additional requirements.
2. Back flow preventer may be required. Check local codes.
3. Thermal expansion tanks are required. Contact NATCO for advice.
4. Additional ball-valves, drain valves, and unions should be used for ease of maintenance (i.e. to isolate and/or drain, heaters, tanks, and pumps).
5. Suggested pipe size must be used throughout, with bushings used to meet connections as necessary. Supply and return pipe diameter must be the same.