




National Combustion Co., Inc.
 104-11 180th Street
 Jamaica, NY 11433
 Ph: 718-291-8400
 Fx: 718-291-6870

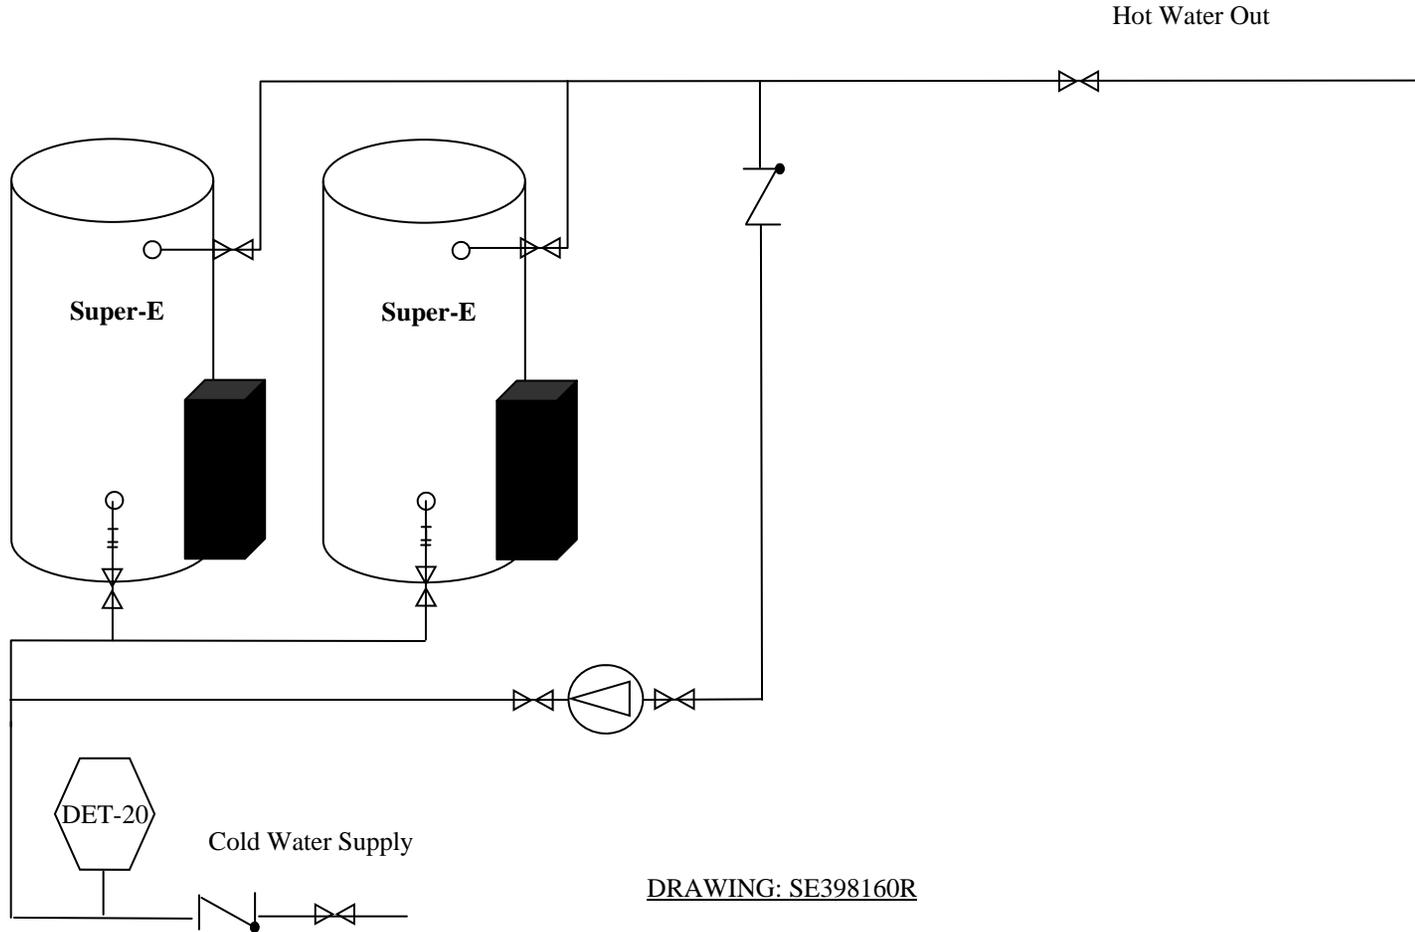

DRAWING: SE398160R

2 80 or 119 Gallon Super-E's w/ recirculation line

Notes:

1. This drawing shows suggested piping configuration. Check local codes and ordinances for additional requirements.
2. Minimum 2" cold water supply & hot water to store lines recommended.
3. Minimum 1" recirculation line is recommended. 2" Optimal.
4. Back flow preventer may be required. Check local codes.
5. Thermal expansion tank is required. NATCO suggests using 1 Watts DET-35 expansion tanks.
6. Additional ball-valves, drain valves, and unions may be used for ease of maintenance.

