




National Combustion Co., Inc.
 104-11 180th Street
 Jamaica, NY 11433
 Ph: 718-291-8400
 Fx: 718-291-6870

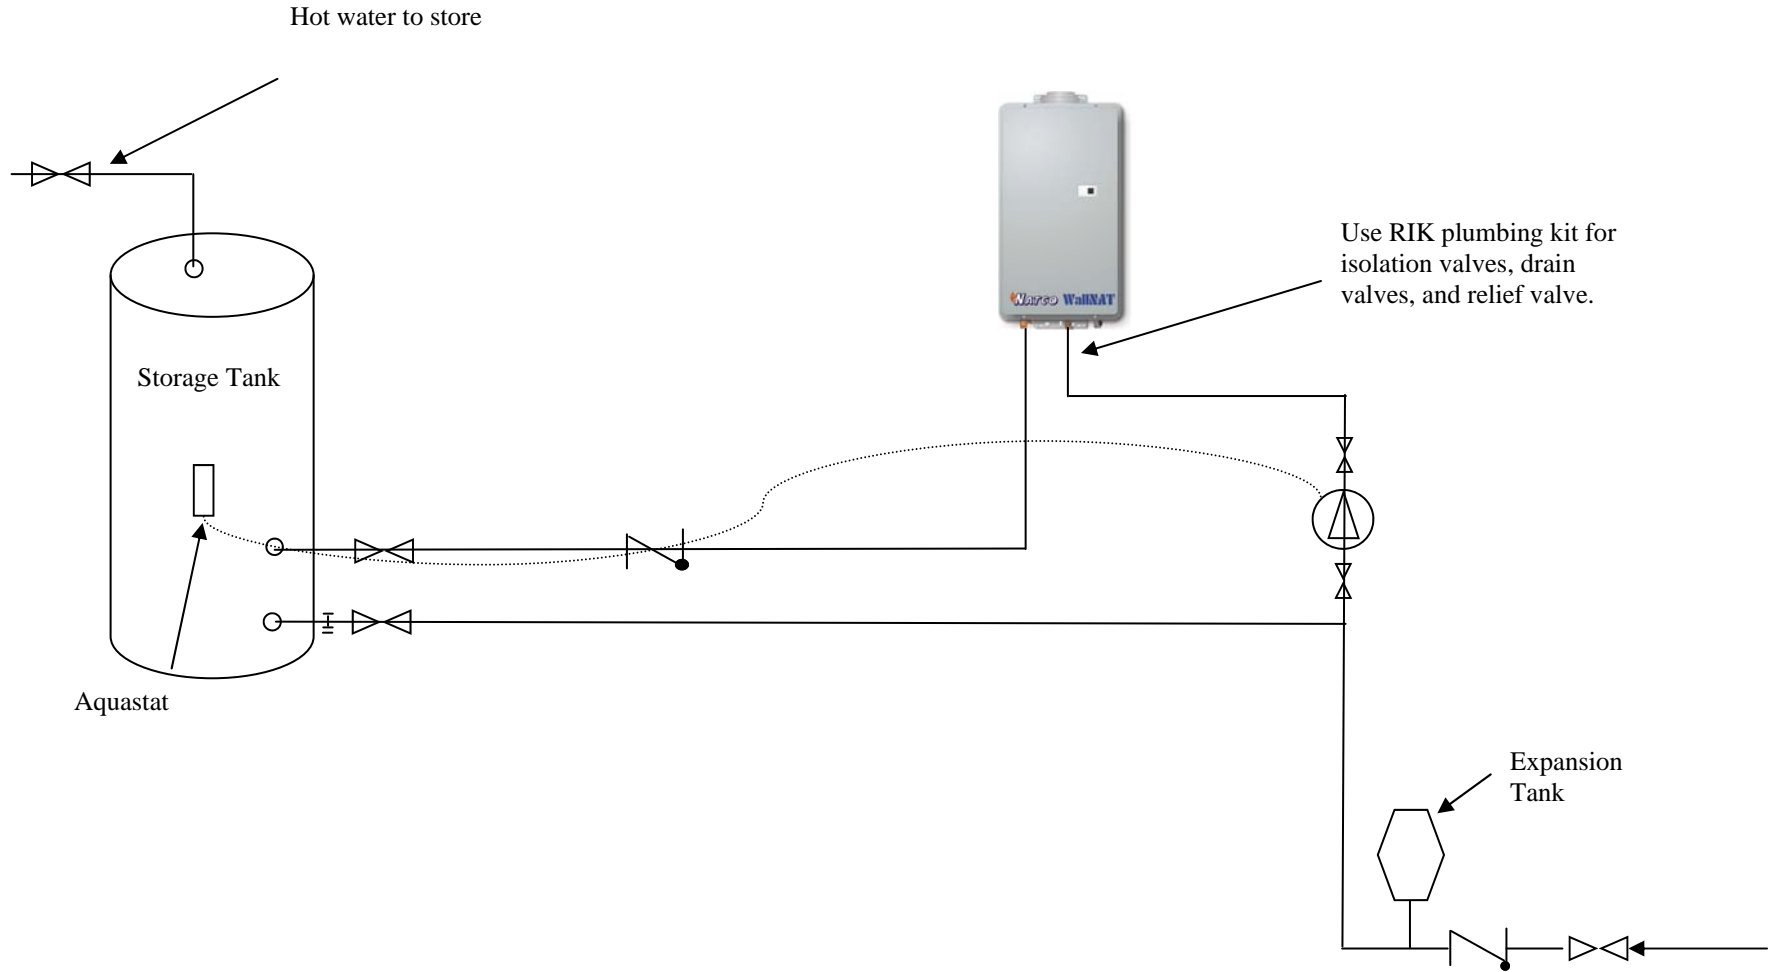

DRAWING: 2 WALLNAT, INDIRECT, STORAGE TANK

1 Wall-Nat Heaters w/Storage Tank

Notes:

1. This drawing shows suggested piping configuration. Check local codes and ordinances for additional requirements.
2. Piping on supply and return directly on Wall-NATS should be 3/4". Piping on remainder of system between storage tank, Wall-Nats, and cold water should be 1".
3. Back flow preventer may be required. Check local codes.
4. **Note: Additional plumbing required near Wall-Nat heaters. See detail in manual.**

Legend



Ball Valve



Circulating Pump



Check Valve



Drain Valve